

MRL Passenger Elevator


Hoistway Structure

Concrete Brick & Concrete Other


Unstandard Standard

NOTE


		TKJW 800 / 1.0 -VF		Technical Requirement:				
HW	HOISTWAY WIDTH	CW	CAR INSIDE WIDTH	Type				
HD	HOISTWAY DEPTH	CD	CAR INSIDE DEPTH	F/P/D	/ / Door type Side open			
OP	DOOR OPENING WIDTH	CH	CAR HEIGHT	load	800 kg speed 1.0 m/s			
ROP	WALL OPENING WIDTH	MRW	MACHINE ROOM WIDTH	Machine	MCK2.00 Roping 2:1			
OPH	DOOR OPENING HEIGHT	MRD	MACHINE ROOM DEPTH	T/sheave	φ 4.00 D/sheave φ			
OH	OVERHEAD HEIGHT	MRH	MACHINE ROOM HEIGHT	car sheave	φ 4.00 CW sheave φ 4.00			
CAR DBG	DISTANCE BETWEEN CAR GUIDE RAILS		Shaft	HW	2400 mm x HD 2200 mm			
CWT DBG	DISTANCE BETWEEN COUNTERWEIGHT GUIDE RAILS		Cabin	CW	1400 mm x CD 1400 mm			
	Door	OP	800 mm x OPH	1400 mm				
	Speed	1.0	1.5	1.75	(m/s)			
	Power	5.4	8.1	9.4	(kw)			
	OH	≥4500	≥4600	≥4700	(mm)			
	Pit	≥1600	≥1700	≥1800	(mm)			
	current				(A)			
	380V 3phase Swire, 50Hz, fluctuation ±7%							
	Support Force (N)							
	R1	R2	R3	R4	P1	P2	P3	P4
	27900	27100	13500	13200	72800	56000		
	Technical Requirement							



The hook

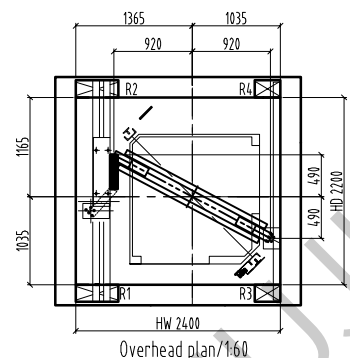


Overhead plan/1:60

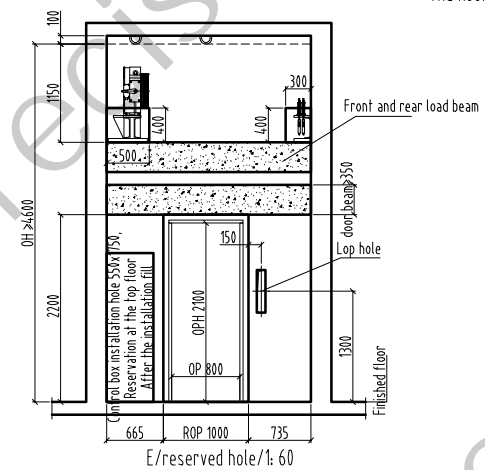


E/reserved hole/1: 60


Bottom box Lop: 100x500 (base station) 100x400 (remaining stations)
No bottom box Lop hole: φ50 hole

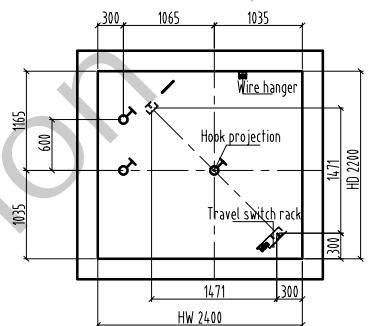


Hoistway plane hook drawing (by hook customer) / 1:60

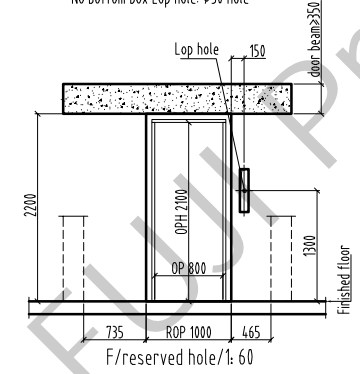


F/reserved hole/1: 60

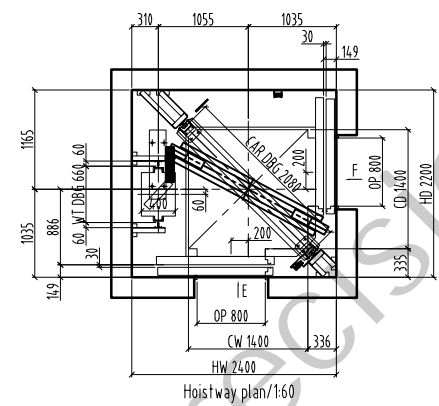

Hoistway plan/1:60

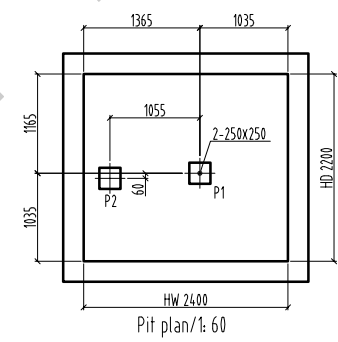

Pit plan/1: 60

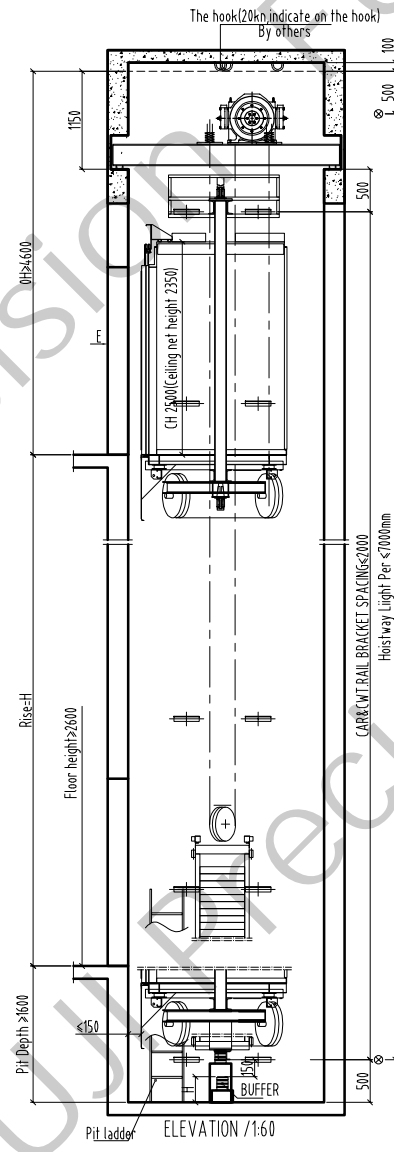

The hook(20kn indicate on the hook)
By others

Hoistway Light Per $\le 1000\text{mm}$

CAR&CWT RAIL BRACKET SPACING≤ 2000

OH	≥4600
Rise	H
26 F	
25 F	
24 F	
23 F	
22 F	
21 F	
20 F	
19 F	
18 F	
17 F	
16 F	
15 F	
14 F	
13 F	
12 F	
11 F	
10 F	
9 F	
8 F	
7 F	
6 F	
5 F	
4 F	
3 F	
2 F	
1 F	
G F	
B F	
Pit	≥1600
Floor	Height

1. Power supply: machine room need equipped with power supply. Power supply box need be locked. Power supply should be 3P 5 wires 380V 50Hz. Voltage tolerance ±7%, input power more than 50% of motor power, also equipped with air switch same capacity with power supply, also allow the supplement leakage protector. When use VVVF need use special leakage switch. Ground resistor should be $\le 4\Omega$. It should use insulated conductor from floor to machine room. Keep separate for null wire and ground wire.

2. Shaft requirement: it should be only for lift, can not install non-related device (pipe, cable etc), and should keep the person entrance into. The shaft plan size mean the min. size measured by plumb line, tolerance $\sim 50\text{mm}$. Basically not allow the protruding beam and column. The proof pressure of shaft side should be $\ge 24\text{MPa}$. Recommend to use full concrete, can not use the reserved steel. In case use solid brick, it should use reserved steel or make the ring beam on the surface of reserved steel, height $\ge 300\text{mm}$. If use hollow brick, can choose C25 concrete fill into the wall. Also make the ring beam on the surface of reserved steel, height $\ge 300\text{mm}$. If the shaft front wall is brick construction, it should make the concrete beam upside of door hole to fix the landing door bracket, height $\ge 300\text{mm}$. If have the requirement in the drawing, it should make the concrete in the entrance of hall door. It should equipped with lamp brightness $\ge 50\text{LX}$, install the lamp at 0.5m from the top and the bottom, in the middle, each lamp at $\le 7\text{m}$. The buffer block should be made accompany with special person. before that, need make the reserved ≥ 4 pcs joint bar, $\ge \phi 12\text{mm}$, height $\ge 500\text{mm}$ from the pit floor. and should water proof. Keep the space for person entrance. Pit ladder is by user. Should installed in a suitable place. if there have basement downside of the pit, should make the buffer block extend to the solid floor downside. If the floor distance between 2 floor $\ge 1\text{m}$, should set the safe door with the width 350mm, height 1800mm.

3. Machine room requirement (not for MRL): If had the passageway for the traction machine, keep the entrance unblocked. the door opens outward, also can be locked. Installed the fan, keep the humidity $\le 85\%$, temperature $+5\text{C} \sim 40\text{C}$ surrounding the reserved hole should make the 50mm hole, keep the floor plan, also bear the load 700kg/m^2 . The motor beam should be supported in the concrete block, this concrete block should extend to the building beam or bearing wall. Bearing side should make the reserved same side steel, thickness 2mm, bearing side thickness should over the wall thickness 20mm, total thickness more than 75mm. Standard wall 200mm, recommend the bearing wall thickness $\ge 200\text{mm}$.

The hook in the machine room should indicate the max. load. It should install the ladder and barrier in case have stair.

Drawing		approver	
Drawing No.	FTKW 800 -30-		
manufacturing no.			
Project name			
	FUJI PRECISION		