

MRL Passenger Elevator

Hoistway Structure

Concrete Brick & Concrete Other


Unstandard Standard

NOTE


Technical Requirement:

HW	HOISTWAY WIDTH	CW	CAR INSIDE WIDTH	Type	TKJW 1150 / 1.0 -VF		
HD	HOISTWAY DEPTH <td>CD</td> <td>CAR INSIDE DEPTH <td>F/P/D</td> <td>3 / 3 / 3</td> <td>Door type</td> <td>Center open</td> </td>	CD	CAR INSIDE DEPTH <td>F/P/D</td> <td>3 / 3 / 3</td> <td>Door type</td> <td>Center open</td>	F/P/D	3 / 3 / 3	Door type	Center open
OP	DOOR OPENING WIDTH <td>CH</td> <td>CAR HEIGHT <td>load</td> <td>1150 kg</td> <td>speed</td> <td>1.0 m/s</td> </td>	CH	CAR HEIGHT <td>load</td> <td>1150 kg</td> <td>speed</td> <td>1.0 m/s</td>	load	1150 kg	speed	1.0 m/s
ROP	WALL OPENING WIDTH <td>MRW</td> <td>MACHINE ROOM WIDTH <td>Machine</td> <td>MONA 320</td> <td>Roping</td> <td>2:1</td> </td>	MRW	MACHINE ROOM WIDTH <td>Machine</td> <td>MONA 320</td> <td>Roping</td> <td>2:1</td>	Machine	MONA 320	Roping	2:1
OPH	DOOR OPENING HEIGHT <td>MRD</td> <td>MACHINE ROOM DEPTH <td>T/sheave</td> <td>φ 320</td> <td>D/sheave</td> <td>φ</td> </td>	MRD	MACHINE ROOM DEPTH <td>T/sheave</td> <td>φ 320</td> <td>D/sheave</td> <td>φ</td>	T/sheave	φ 320	D/sheave	φ
OH	OVERHEAD HEIGHT <td>MRH</td> <td>MACHINE ROOM HEIGHT <td>car sheave</td> <td>φ 320</td> <td>CW sheave</td> <td>φ 320</td> </td>	MRH	MACHINE ROOM HEIGHT <td>car sheave</td> <td>φ 320</td> <td>CW sheave</td> <td>φ 320</td>	car sheave	φ 320	CW sheave	φ 320
CAR DBG	DISTANCE BETWEEN CAR GUIDE RAILS			Shaft	HW 2120 mm x HD 2120 mm		
CWT DBG	DISTANCE BETWEEN COUNTERWEIGHT GUIDE RAILS			Cabin	CW 1450 mm x CD 1700 mm		
				Door	OP 900 mm x OPH 2100 mm		


Compact type




Speed limiter base detail



The hook

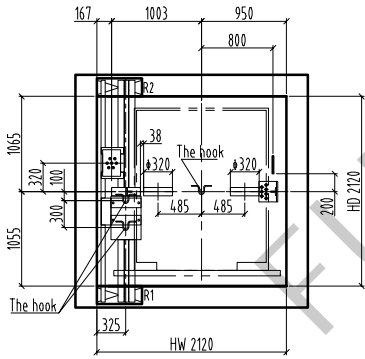


Overhead plan/1:60

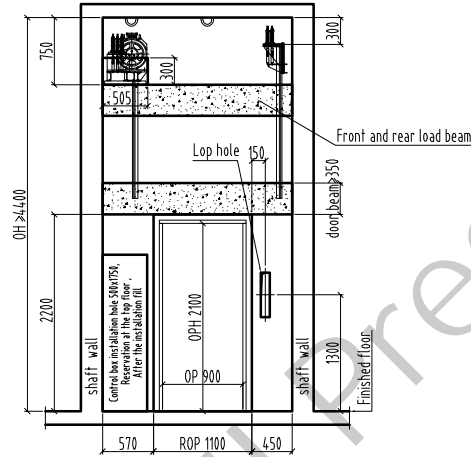


E/reserved hole/1: 60


Bottom box Lop: 100x500 (base station) 100x400 (remaining stations)
No bottom box Lop hole: φ50 hole

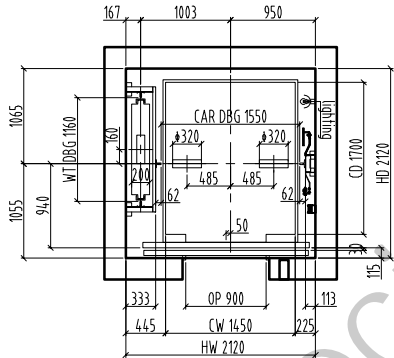

Hoistway plan/1:60

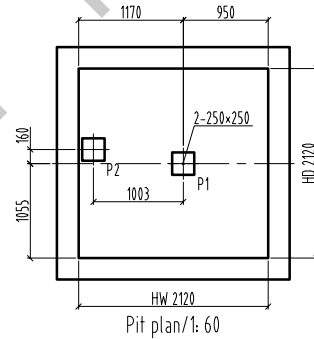

Pit plan/1: 60

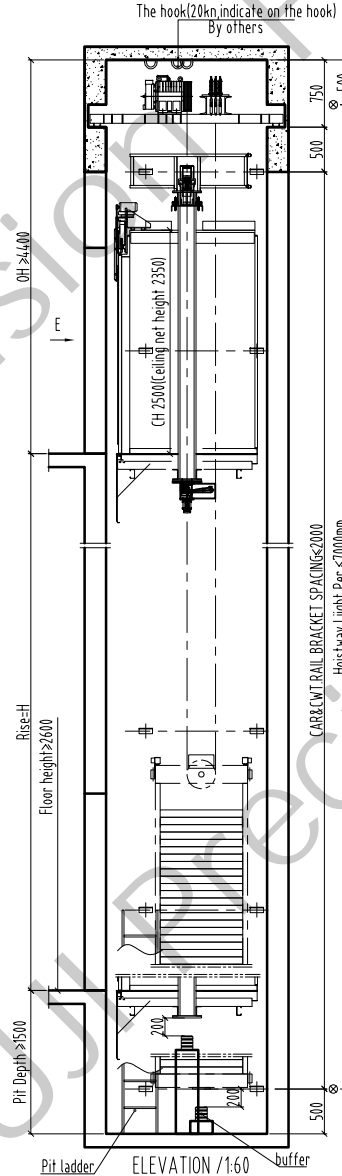

The hook(20kg indicate on the hook)
By others

OH	>=4400
Rise	H
26 F	
25 F	
24 F	
23 F	
22 F	
21 F	
20 F	
19 F	
18 F	
17 F	
16 F	
15 F	
14 F	
13 F	
12 F	
11 F	
10 F	
9 F	
8 F	
7 F	
6 F	
5 F	
4 F	
3 F	
2 F	
1 F	
G F	
B F	
Pit	>=1500
Floor	Height

Drawing approver

Drawing No. FTKW 1150 -01-

Project name

FUJI PRECISION

Technical Requirement:

380V 3phase 5wire, 50Hz, fluctuation ±7%

Support Force (N)

R1	R2	R3	R4	P1	P2	P3	P4
31400	39600			88000	68000		

Technical Requirement

1. Power supply: machine room need equiped with power supply. Power supply box need be locked. Power supply should be 3P.5 wires, 380V 50Hz. Voltage tolerance ±7%, input power more than 50% of motor power, also equiped with air switch same capacity with power supply, also allow the supplement leakage protector. When use VVVF, need use special leakage switch. Ground resistor should be < 4Ω. It should use insulated conductor from floor to machine room. Keep separate for null wire and ground wire.

2. Shaft requirement, it should be only for lift, can not install non-related device(pipe, cable etc), and should keep the person entrance into. The shaft plan size mean the min size measured by plumb line, tolerance ±50mm. Basically not allow the protruding beam and column. The proof pressure of shaft side should be >= 24MPa. Recommend to use full concrete, can not use the reserved steel. In case use solid brick, it should use reserved steel or make the ring beam on the surface of reserved steel, height >= 300mm. If use hollow brick, can choose C25 concrete fill into the wall, also make the ring beam on the surface of reserved steel, height >= 300mm. If the shaft front wall is brick construction, it should make the concrete beam upsid of door hole to fix the landing door bracket, height >= 300mm. If have the requirement in the drawing, it should make the concrete in the entrance of hall door. It should equiped with lamp, brightness >= 50lx, install the lamp at 0.5m from the top and the bottom, in the middle each lamp at <= 1m. The buffer block should be made accompany with special person. before that need make the reserved 240x240 joint bar >= 12mm, height >= 500mm from the pit floor, and should water proof. Keep the space for person entrance. Pit ladder is by user. Should installed it in a suitable place. if there have basement downside of the pit should make the buffer block extend to the solid floor downside. If the floor distance between 2 floor >= 1m, should set the safe door with the width 350mm, height 1800mm.

3. Machine room requirement(not for MRL). It had the passageway for the traction machine. keep the entrance unblocked. the door opens outward, also can be locked. Installed the fan, keep the humidity < 85%, temperature +5C-40C, surrounding the reserved hole should make the 50mm hole, keep the floor plan, also bear the load 700kg/m². The net or beam should be supported in the concrete block, this concrete block should extend to the building beam or bearing wall. Bearing side should make the reserved same side steel. thickness 2mm, bearing side thickness should over the wall thickness 20mm, total thickness more than 75mm. Standard wall 200mm, recommed the bearing wall thickness >= 200mm. The hook in the machine room should indicate the max. load. It should install the ladder and barrier in case have stair.